

140 CHATFIELD-HOLLIS-CANTON
134 MAYBID
SOIL CLASS: 33 SCITICO

(SOURCE: USDA-SCS SOIL SURVEY)

BENCH MARKS: DATUM = ASSUMED

#1 SET NAIL TRIPLE 48" PINE EL 60.77

#2 SET NAIL ROOT 15" OAK EL 50.54

#3 SET NAIL ROOT 12" DBL OAK EL 61.73

DESIGN INTENT: THE BOTTOM OF THE EDS
SHALL BE CONSTRUCTED AT EL 56.5, THERE
IS APPROX 6" ABOVE ORIGINAL GROUND ON THE
HIGH CONTOUR OF THE DESIGNED EDS.
EQUALS 18" ABOVE OG AT EL 55 (25%+ OF BED
SUITABLE REPLACEMENT AREA: AREA DOWNSLOPE)

SYSTEM MUST BE REBUILT IN PLACE OR REDESIGNED.

LEGEND:

- 50.0 EXISTING CONTOUR
- (50.0) PROPOSED CONTOUR
- 50.0 EXISTING SPOT ELEVATION
- (50.0) PROPOSED SPOT ELEVATION

PREVIOUS CONSTRUCTION
APPROVAL #CA2001036745

NOTES:
1. THIS PLAN IS NOT TO BE CONSTRUED AS A
BOUNDARY SURVEY. PROPERTY LINES SHOWN
ARE APPROXIMATED BASED ON INFORMATION
FROM THE FOLLOWING SOURCE:

RORD PLAN D 29642




2. NHDES-WS&PCD SUBDIVISION APPROVAL
NUMBER: N/A LOT OF RECORD OVER 5 AC
RORD PLAN C16329

3. THIS SYSTEM IS NOT DESIGNED TO HANDLE
GARBAGE DISPOSAL WASTE.


4. NO SURFACE WATER OR WELL WITHIN 75'
OF PROPOSED SYSTEM.

5. WETLAND BOUNDARY DELINEATED
BY MARK WEST, WEST ENVIRONMENTAL

6. CONSTRUCTION AND SEPTIC SETBACK
LINES ARE AS PER PREVIOUS APPROVAL

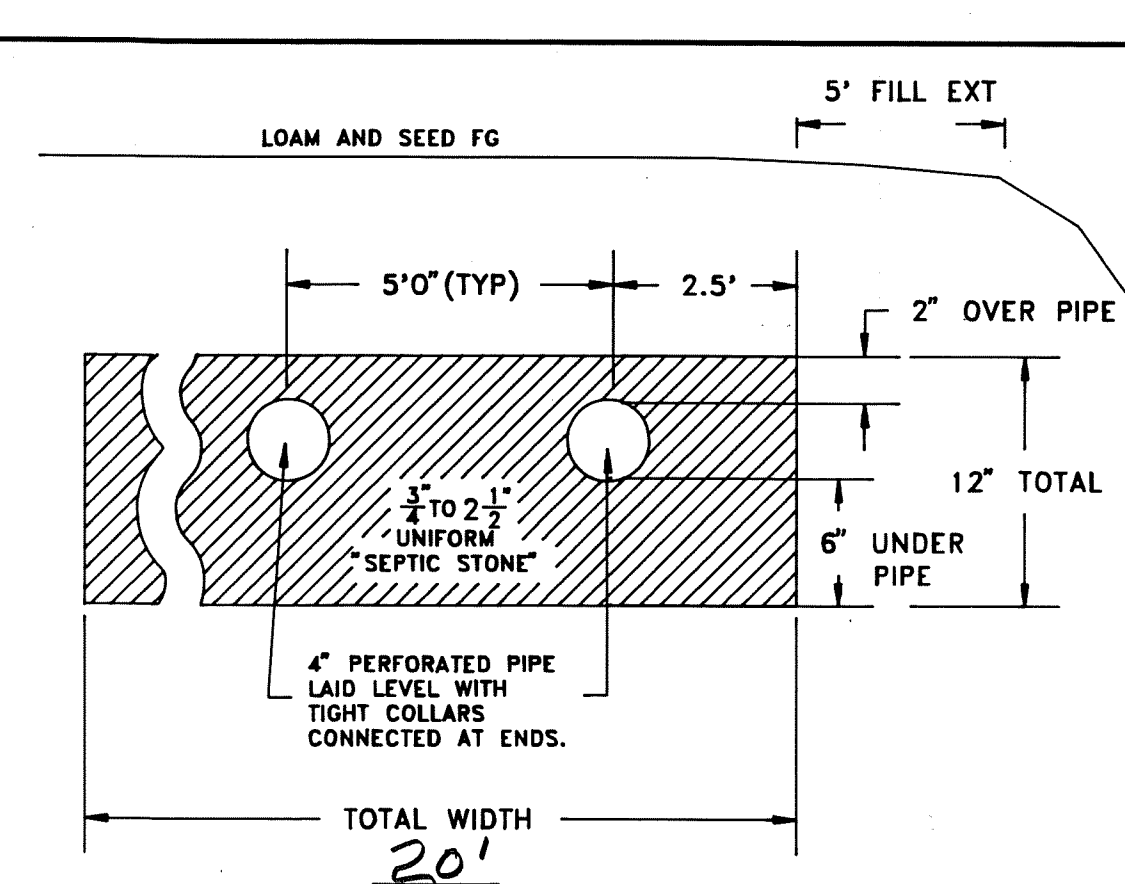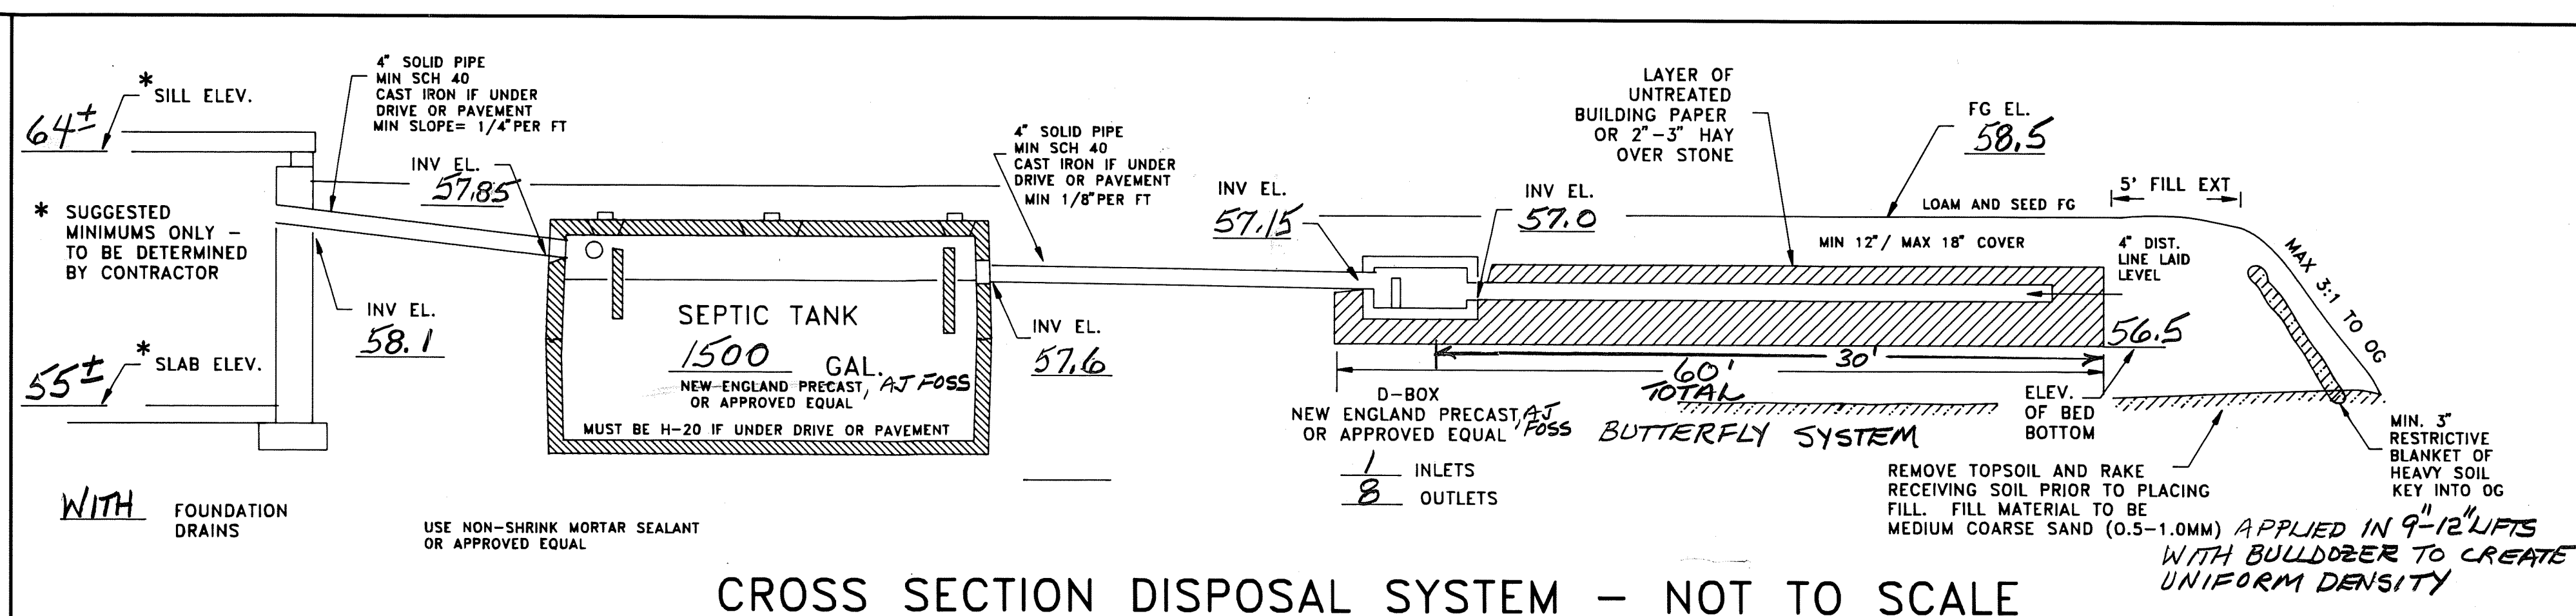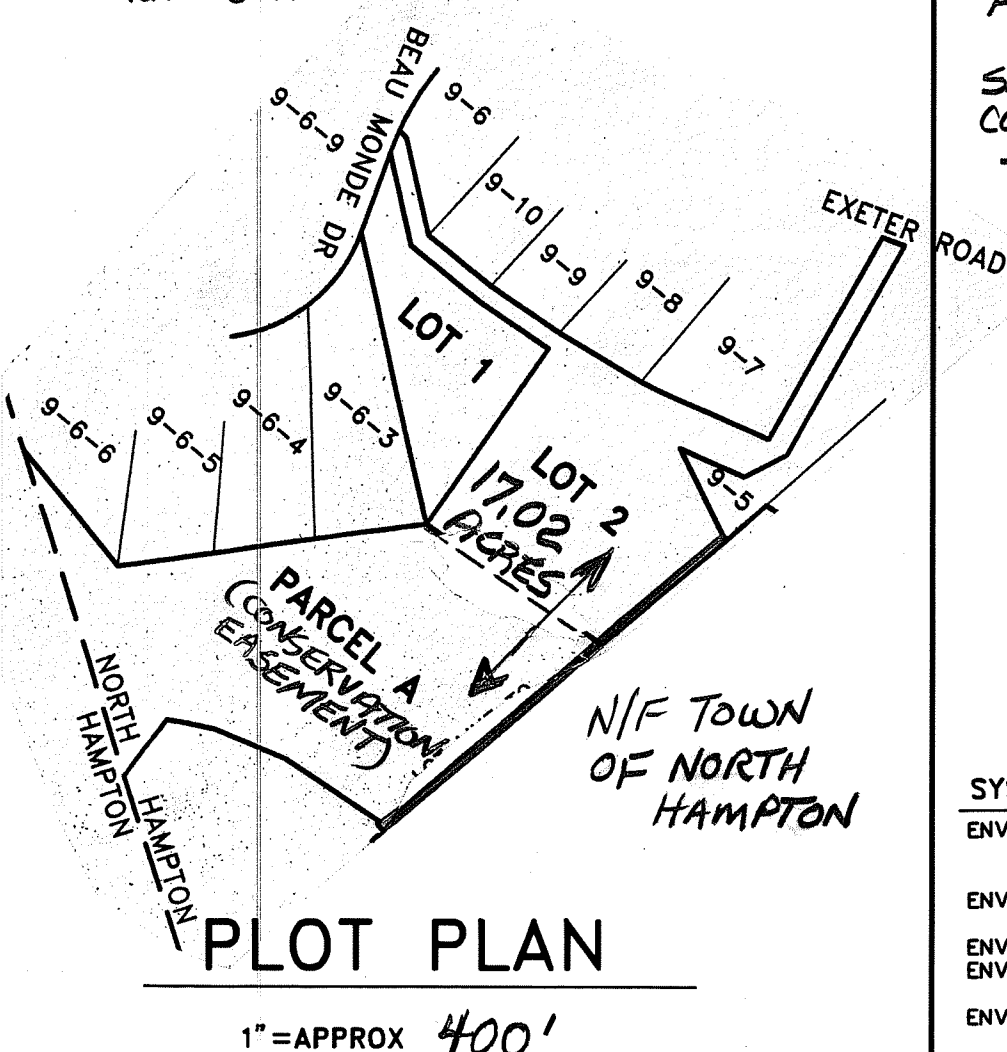

NOTE: REFERENCE
NHDES - WETLANDS
BUREAU PERMIT
2001-1204 -
DRIVEWAY CROSSING
HAS BEEN COMPLETED.

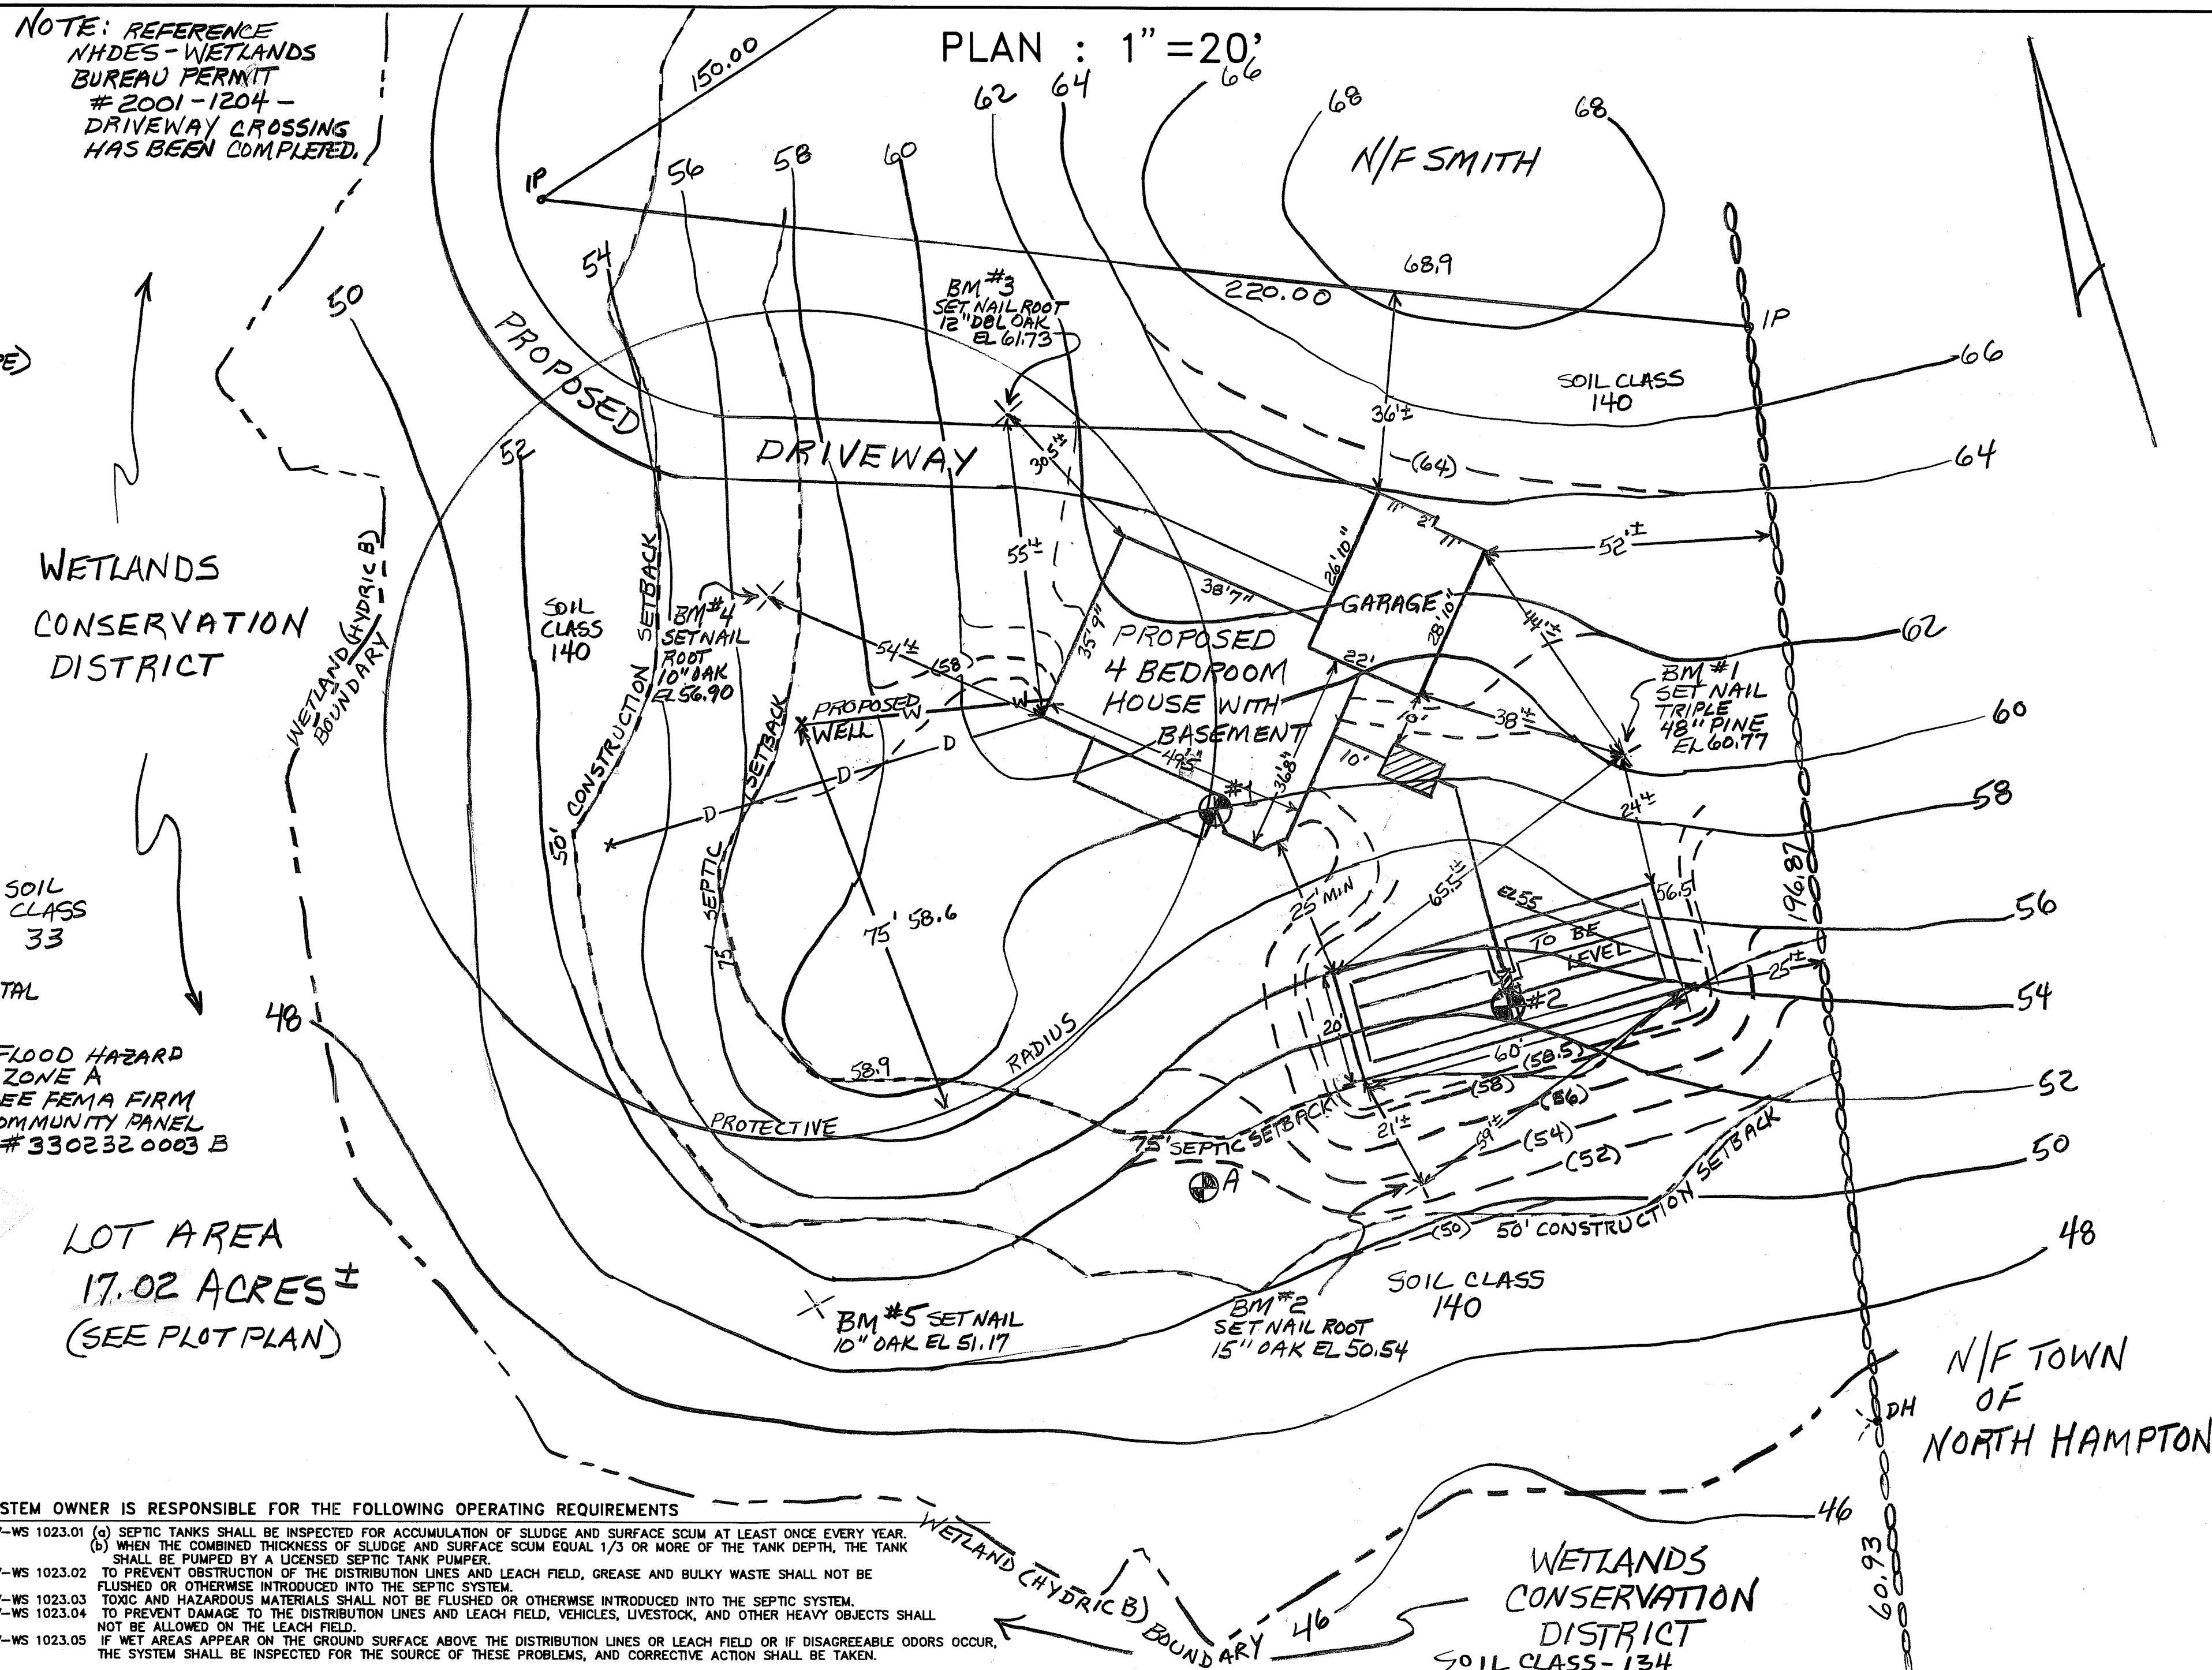

TEST PIT DATA

DATE: 6/18/01

TOWN INSPECTOR: MIKE CUOMO

#1 EL 58.0

0-4" LOAM & ROOT MAT
4-18" 7.5YR 4/4 FINE SANDY LOAM, GRANULAR FRIABLE
18-28" 2.5Y 5/4 VERY FINE SANDY LOAM, BLOCKY, FRIABLE
28-40" 2.5Y 5/4 FINE SANDY LOAM, MASSIVE, FIRM, MOTTLED
ESHW@ 28" NO OBSERVED WATER
REFUSAL (LEDGE) @ 40", ROOTS TO 36" +

#2 EL 52.5

0-4" LOAM & ROOT MAT
4-30" 10YR 4/4 FINE SANDY LOAM, GRANULAR FRIABLE
30-52" 2.5Y 5/4 FINE SANDY LOAM, BLOCKY, FIRM, MOTTLED

ESHW@ 30" NO OBSERVED WATER
REFUSAL @ 52" (LEDGE), ROOTS TO 40" +

A LEDGE PROBE

ESHW@ 12" LEDGE @ 60"
OBS 40" @ 60"

PERC TEST DATA

DATE: 6/18/01

PERC RATE: 10 MIN/IN DEPTH: 24"

DESIGN LOADING: 4 BEDROOMS

AREA REQUIRED: 1100 SF

AREA PROPOSED: 20 x 60 = 1200 SF

PROPOSED REVISED SEPTIC SYSTEM PLAN

PREVIOUS APPROVAL #CA2001036745


LOCUS: 92 EXETER ROAD

NORTH HAMPTON, NH

OWNER: KEVIN GREGORY

2 BEAUMONDE DRIVE

NORTH HAMPTON, NH 03862

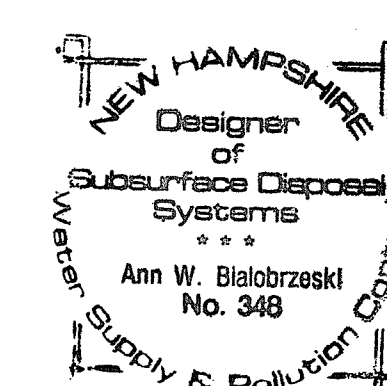

APPLICANT:
STOCKTON SERVICES
PO BOX 1306
HAMPTON, NH 03842

DATE: 6/9/03

APPROVAL: CA2003053767

254 REV

